



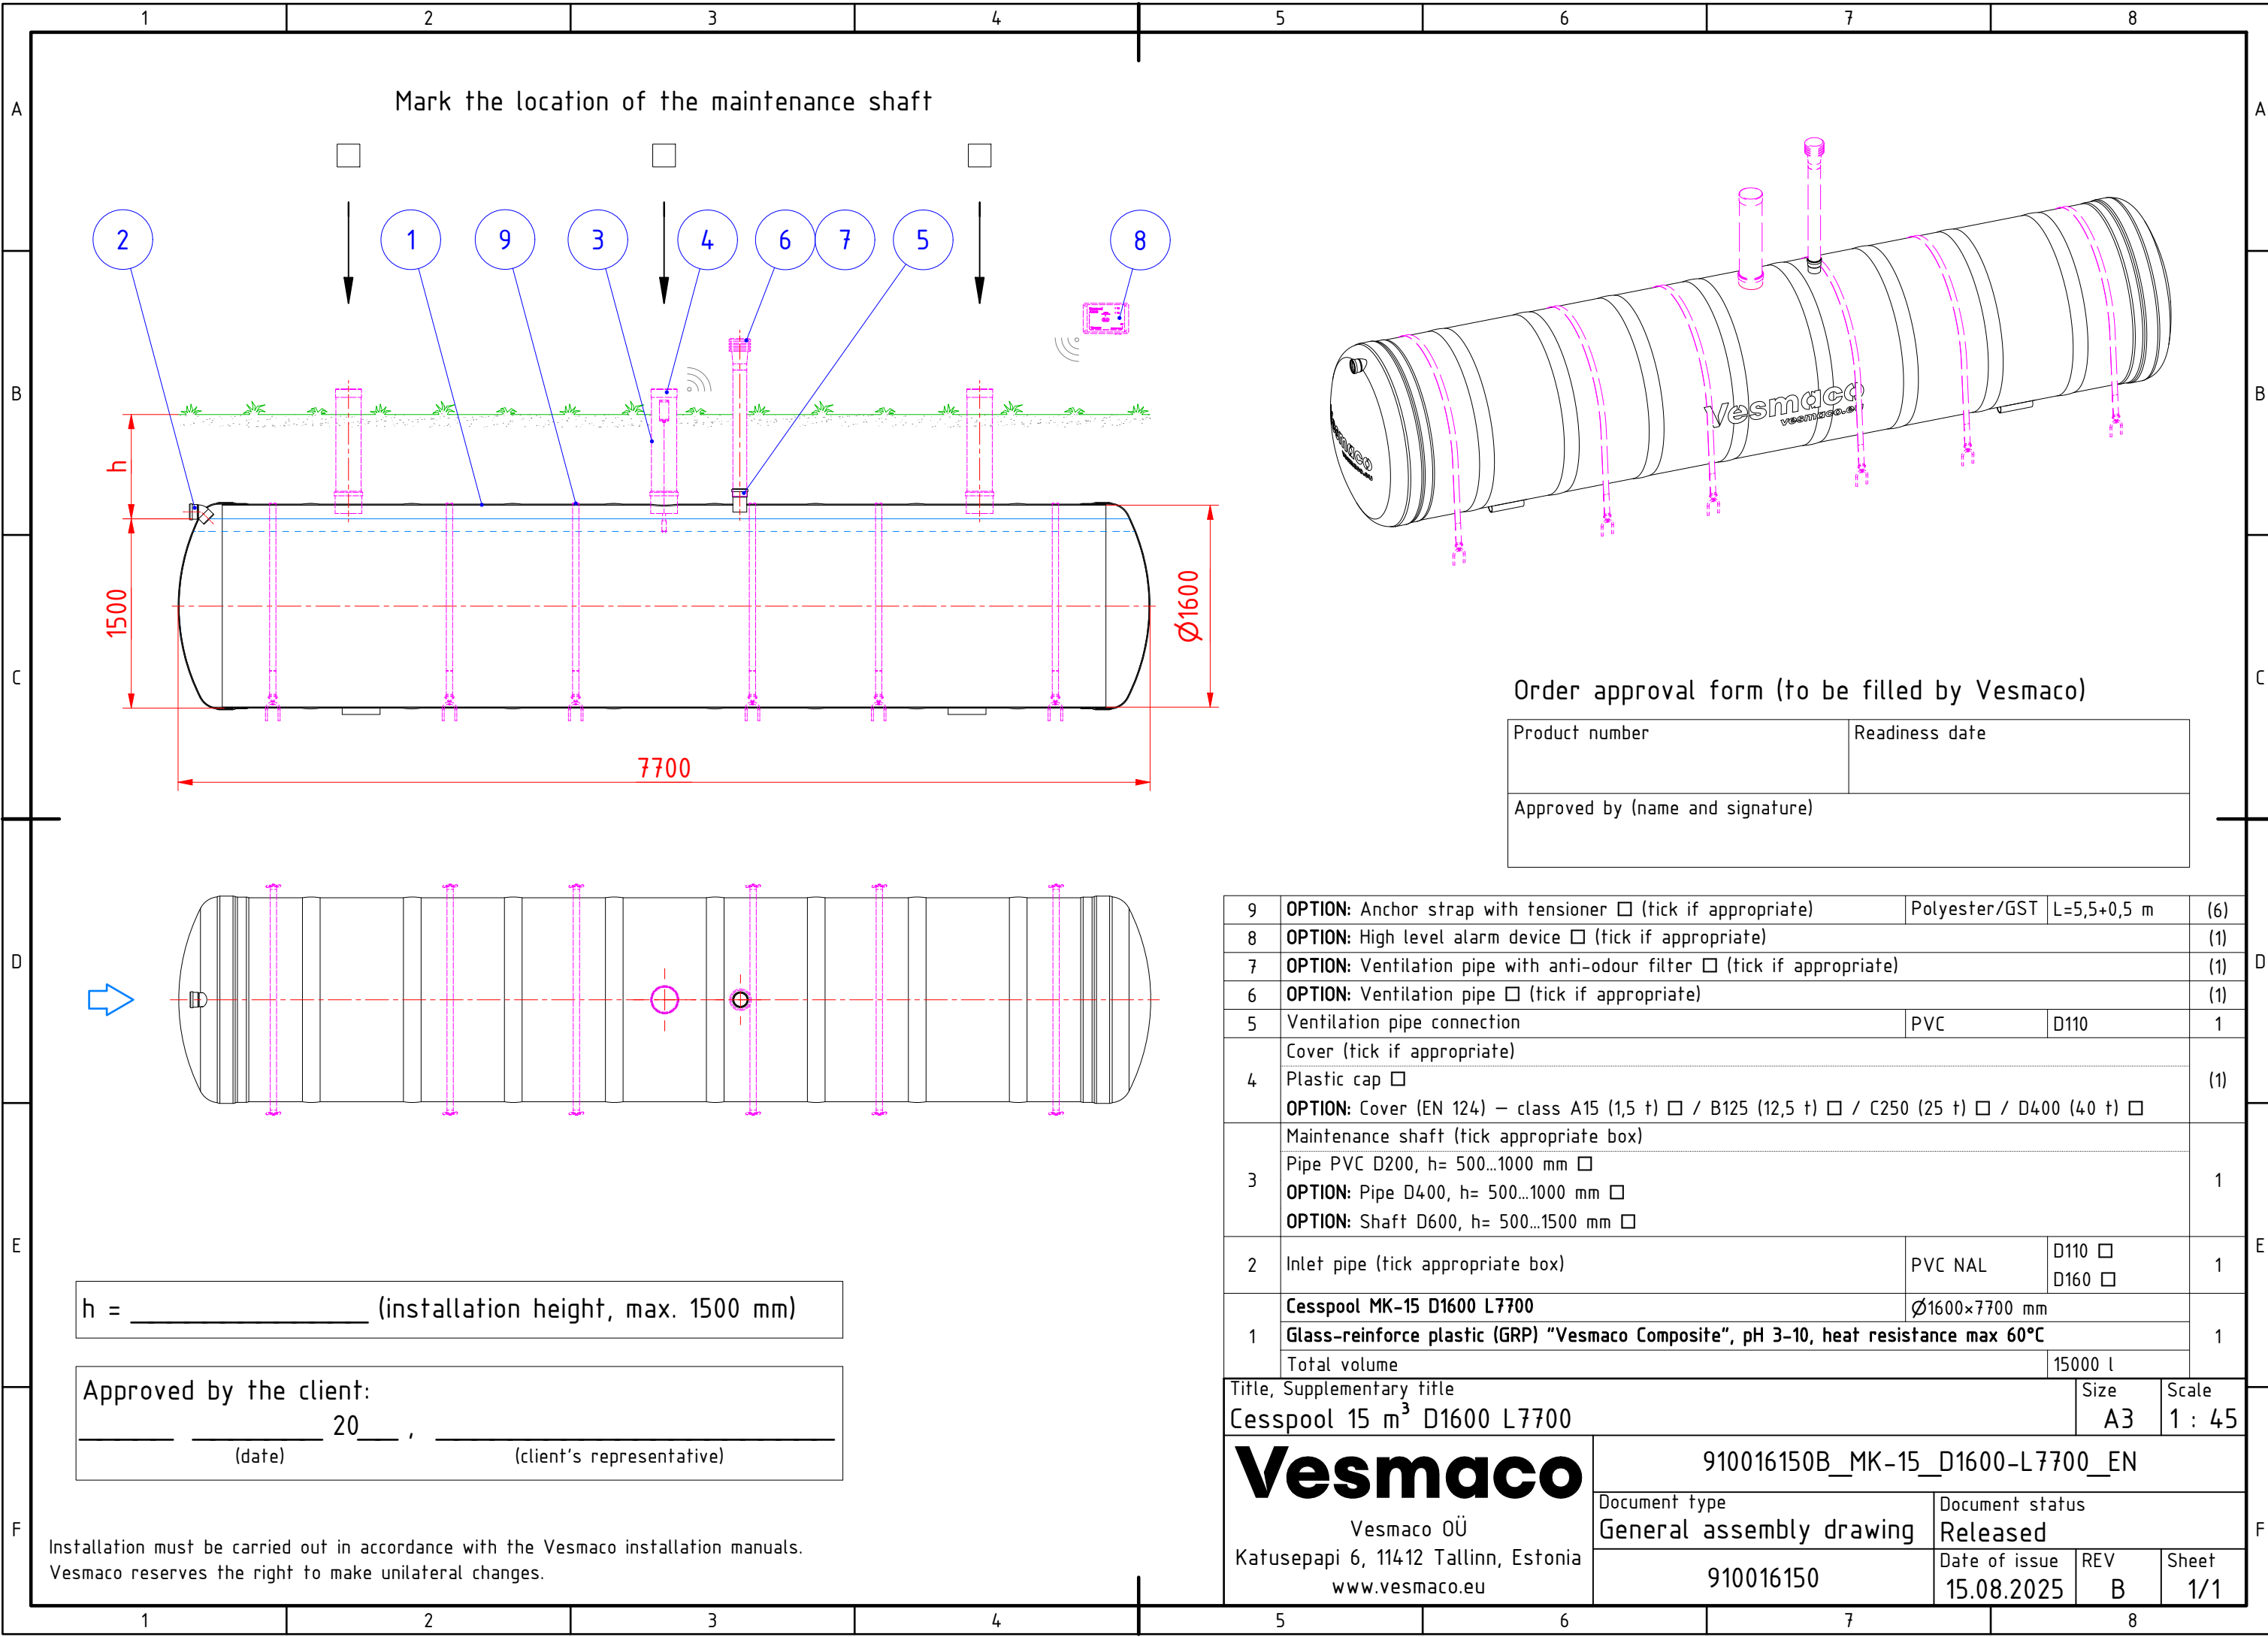

Mark the location of the maintenance shaft

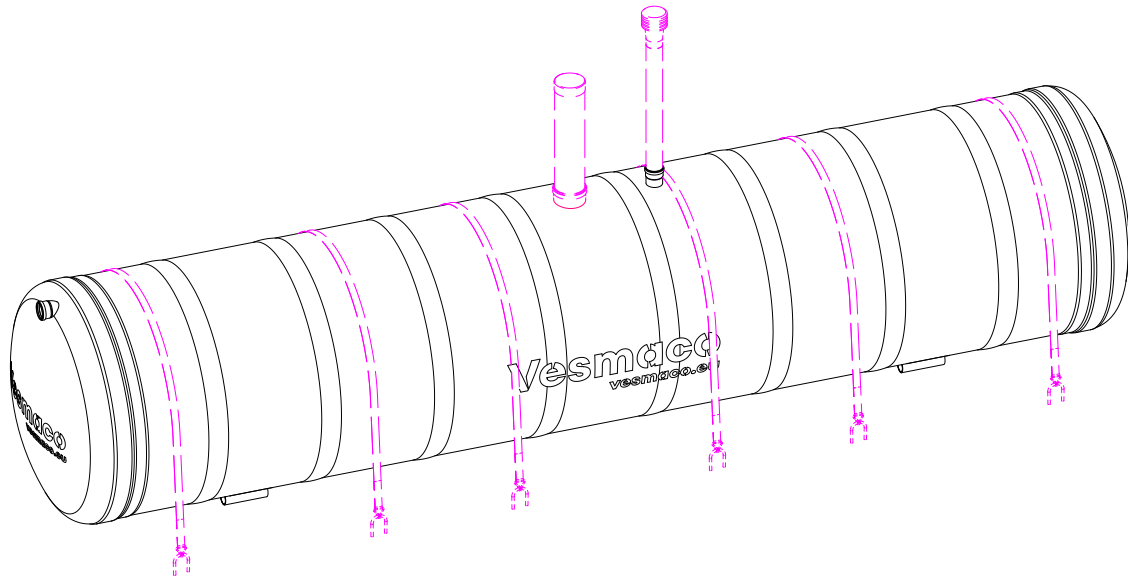

Order approval form (to be filled by Vesmaco)

Product number	Readiness date
Approved by (name and signature)	

9	OPTION: Anchor strap with tensioner ☐ (tick if appropriate)		Polyester/GST	L=5,5+0,5 m	(6)	
8	OPTION: High level alarm device ☐ (tick if appropriate)					(1)
7	OPTION: Ventilation pipe with anti-odour filter ☐ (tick if appropriate)					(1)
6	OPTION: Ventilation pipe ☐ (tick if appropriate)					(1)
5	Ventilation pipe connection		PVC	D110	1	
4	Cover (tick if appropriate)					(1)
	Plastic cap ☐ OPTION: Cover (EN 124) – class A15 (1,5 t) ☐ / B125 (12,5 t) ☐ / C250 (25 t) ☐ / D400 (40 t) ☐					
3	Maintenance shaft (tick appropriate box)					1
	Pipe PVC D200, h= 500...1000 mm ☐					
	OPTION: Pipe D400, h= 500...1000 mm ☐ OPTION: Shaft D600, h= 500...1500 mm ☐					
2	Inlet pipe (tick appropriate box)		PVC NAL	D110 ☐ D160 ☐	1	
1	Cesspool MK-15 D1600 L7700		Ø1600×7700 mm		1	
	Glass-reinforce plastic (GRP) “Vesmaco Composite”, pH 3-10, heat resistance max 60°C					
	Total volume					15000 l

h = _____ (installation height, max. 1500 mm)

Approved by the client:
_____, _____
(date) (client's representative)

Installation must be carried out in accordance with the Vesmaco installation manuals.
Vesmaco reserves the right to make unilateral changes.

Title, Supplementary title Cesspool 15 m ³ D1600 L7700		Size A3	Scale 1 : 45
Vesmaco Vesmaco OÜ Katusepapi 6, 11412 Tallinn, Estonia www.vesmaco.eu	910016150B_MK-15_D1600-L7700_EN		
	Document type General assembly drawing	Document status Released	
	910016150	Date of issue 15.08.2025	REV B
			Sheet 1/1